
BROOK VENT

Market Leading Heat Recovery Ventilation







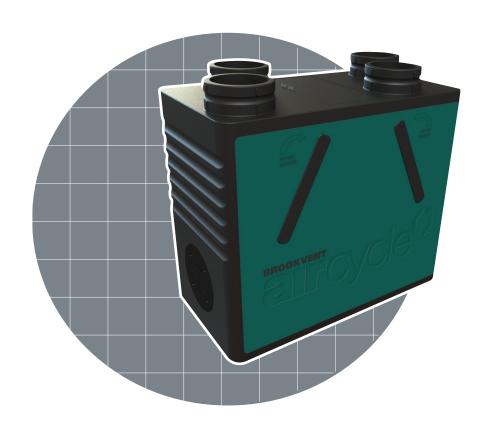










Combining market leading heat exchange efficiency with extremely low energy usage, the aircycle 1.2 provides superior air comfort levels whilst minimising heat wastage.

SUPERIOR AIR QUALITY


The aircycle 1.2 operates by recovering heat from air that would normally be expelled into the atmosphere. This heat is transferred to fresh air drawn into the property, which is then filtered and distributed throughout.

The aircycle 1.2 can significantly reduce the space heating bill of a domestic dwelling, whilst also delivering a healthier and more comfortable environment for the occupier. The aircycle 1.2 eliminates many issues caused by poor indoor air quality within the home such as condensation and the resultant formation of 'black mould'. Additionally, the advanced air filtration system ensures the home environment is much more conducive to allergy and asthma sufferers alike.

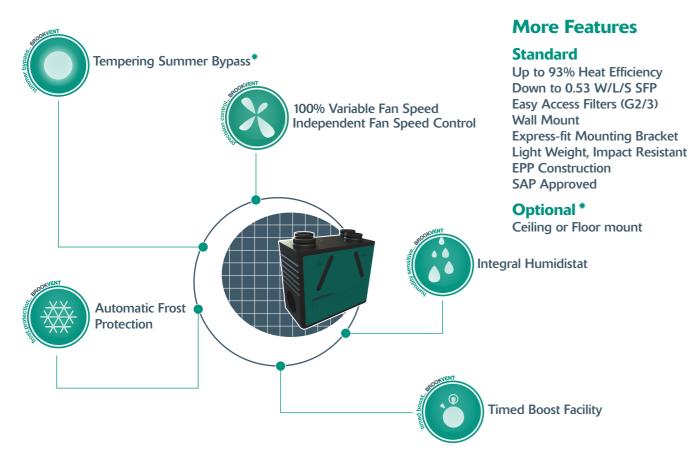



SPECIALLY **DESIGNED FOR APARTMENTS AND** SMALL HOUSES WHERE SPACE CAN BE LIMITED.





DOWN TO 0.53 W/L/S SPECIFIC FAN POWER.

HIGH PERFORMANCE IN A COMPACT PACKAGE

Despite its size, the aircycle 1.2 is one of the best performing Heat Recovery Ventilation units in its class and is both SAP Appendix Q Approved and Energy Savings Trust 'Best **Practice'** compliant. Its efficient performance significantly contributes to lower Dwelling Emission Rates (DER's) in SAP and is suitable for use in homes being built to levels 3,4,5 and 6 of the Code for Sustainable homes.

AUTOMATIC CLIMATE REGULATION


Sophisticated in-built technology enables the unit to respond intuitively to a range of internal and external temperature changes. The aircycle 1.2 offers in-built automatic frost protection and humidity controls that respond to extreme cold spells and changes in humidity within the dwelling, protecting the unit whilst ensuring a comfortable indoor environment for the occupier.

The aircycle 1.2 also has the option of being supplied complete with a unique in-built 'Tempering' Summer Bypass suitable for warmer regions. Unlike most other Heat Recovery Units which offer simply a 100% Summer Bypass at a defined temperature, the **Brookvent 'Tempering'** Summer Bypass operates on a linear scale between 20 Degrees Celsius (No Summer Bypass) and 27 Degrees Celsius (Full Summer Bypass). This gradually increases the amount of air directed around the Heat Recovery Core ensuring the delivery of a comfortable indoor environment for the occupier.

VENTILATION SIMPLICITY

The aircycle 1.2 succeeds in making Heat Recovery Ventilation Installation much simpler. Supplied complete with a flying lead, the unit can be easily connected to a power supply. 100% variable fan speed ensures precise commissioning through independent fan adjustment. Maintenance has also been made much simpler with the only requirement being a regular filter change (every 9-12 months). The filters on the new aircycle 1.2 can be quickly and easily accessed via the airtight tabs on the front of the unit.











SPECIFICATION

Dimensions	583mm x 600mm x 337mm								
Weight	10kg								
Materials	Main enclosure: Impact Resistant EPP (Expanded Polypropylene) PCB Enclosure: Nylon 6 V0 Drainage Tray: HIPS Filters: Polyester Media (G2/3) Mounting Bracket: Zinc Plated Steel								
Electrical	240V EC EC Low Energy Fans Supplied with a flying lead								
Controls	Extremely efficient in-built control board (SAP Q Approved) Independent Fan Speed Control (Trickle and boost settings for each fan) Single 240v boost input (Light Switch, Humidistat, PIR, etc) 15 Min Over-run In-built Humidity Sensor (Boost activation) Variable: 60% - 90% RH, Factory Set: 70% Frost Protection, Variable Activation: 0 – 10 Degrees Cel., Factory Set: 5 Degrees Cel. Optional 'Tempering' Summer Bypass (Variable between 20 and 27 Degrees Cel.)								
Installation	Wall mount. Ceiling and Floor mount versions are also available.								
Standards	Fully complies with Building Regulations for UK & Ireland SAP Q Approved Energy Savings Trust Best Practice CE								
Specific Fan Power: Heat Recovery Efficiency: Guarantee Period:	From 0.53 w/l/s Up to 93% Efficiency 5 Years								


SAP APPENDIX Q: APPROVED RESULTS

Heat Exchange Efficiency (%)			


ACOUSTIC PERFORMANCE

AIRFLOW PERFORMANCE CURVE


		Airflow	Pressure	Lf (MAX)								Overall	Casing
		I/s	Pa	125	250	500	1000	2000	4000	8000	Overall Lw	Lwa	Breakout dBA @
Speed 1	Open Supply Duct	16	6	32.3	32.7	36	37.8	28.5	21.9	19.2	37	31	3M
	Open Extract Duct	17	2	30	26.9	30.7	33.2	25.4	19.2	18.1	34	28	10
	Breakout	19	4	27.4	26	32.6	30.5	29.6	22.1	19.6	34	28	
Speed 2	Open Supply Duct	28	12	28.2	39.2	52.5	50.1	42.4	33.9	24.7	49	44	
	Open Extract Duct	29	10	31.7	29.7	47.3	40	33.3	28	22.2	41	34	19
	Breakout	31	9	30.8	33.6	46.4	46.8	34	27.4	21.4	43	37	
Speed	Open Supply Duct	38	18	33.8	40.8	56.7	55.8	51.7	42.6	30.3	56	46	
3	Open Extract Duct	42	25	37.8	34.3	50.6	49.1	34.9	34.2	24.8	48	41	24
	Breakout	42	16	28.7	33.3	50.3	46.2	40.4	33.8	25.4	48	41	
Speed	Open Supply Duct	49	31	48.3	44.8	61.3	64.5	56.9	50.3	39.9	64	55	
4	Open Extract Duct	53	43	45.9	36.2	52.4	59.9	36.5	40.1	26.2	54	50	32
	Breakout	54	30	49.1	35.3	54.1	56.2	47	40.6	35.1	56	50	
Speed 5	Open Supply Duct	66	40	43.6	47.6		66.2	63.4	54.2	45.7	64	58	
	Open Extract Duct	60	55	42	40.5	56.1	58.8	43.2	41.7	39.2	60	51	33
	Breakout	66	40	36.9	35.7	57.4	60.5	52.9	45.4	40.4	60	51	

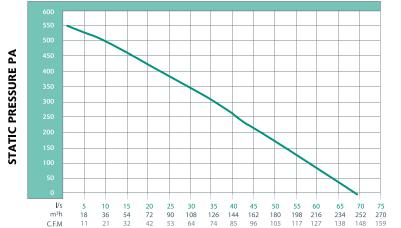

BROOKVENT CYCLE ()



Standard ConfigurationInverted Configuration

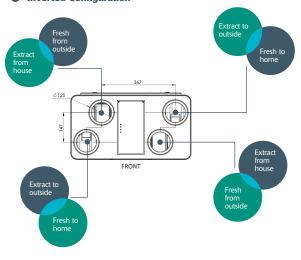

BROOK VENT

Brook House

Dunmurry Industrial Estate

Dunmurry

Belfast BT17 9HU

t: +44 (0) 28 9061 6505

f: +44 (0) 28 9061 6518